



**aerotech**

**Size 36**


Outlet Area 7.75 Sq.Ft.

**FEG 75**

Outlet Velocity

FPM

400 500 1000 1500 2000 2500 3000

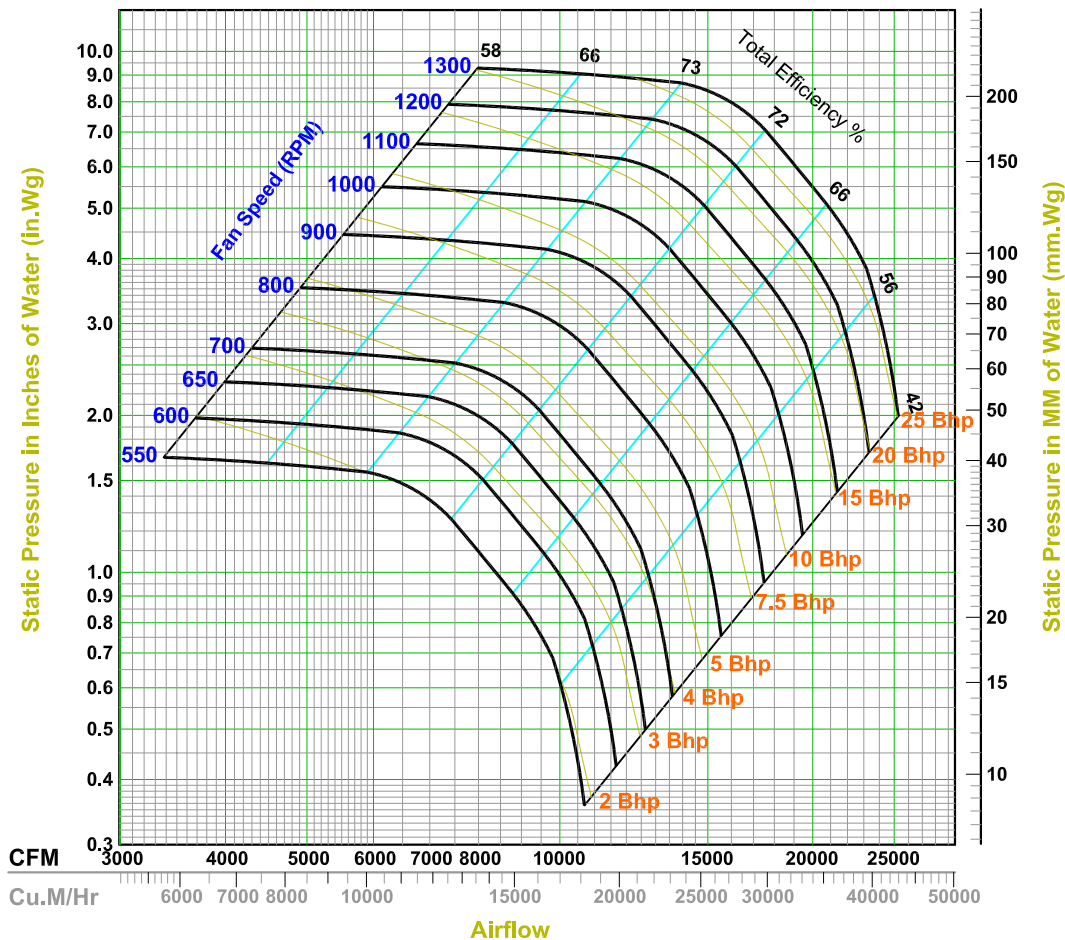

Performance certified is for installation type B - Free inlet, Ducted outlet. Power rating bhp does not include transmission losses. Performance ratings do not include the effects of appurtenances (accessories).


### Sound Power Levels

Software Version AESOFT-001-November-2012

N RPM	Ps in.Wg	Lwi (dB) at Center Frequency (Hz)								LwA
		63	125	250	500	1K	2K	4K	8K	
550	0.94	76	79	76	74	69	69	69	69	77
	1.56	77	76	73	70	67	68	70	72	77
	1.64	80	78	75	72	68	69	70	70	77
	1.12	78	80	79	76	72	71	71	71	79
600	1.85	80	77	76	72	69	70	72	74	79
	1.95	83	79	78	74	71	70	71	72	79
	1.31	80	82	81	78	74	72	72	72	81
650	2.17	83	79	78	74	71	72	74	76	81
	2.29	86	81	80	76	73	72	73	74	81
	1.52	83	84	83	80	76	74	74	74	83
700	2.52	86	81	80	76	73	73	75	77	82
	2.66	88	84	82	78	75	73	74	75	83
	1.99	86	87	87	83	80	77	77	77	87
800	3.29	91	85	84	80	77	75	77	79	85
	3.47	92	88	86	82	78	76	77	78	86
900	2.52	90	89	91	86	84	79	79	79	90
	4.17	96	89	88	83	80	78	80	82	88
	4.40	96	92	90	85	82	79	80	80	89
	3.11	93	92	94	89	87	82	82	82	92
1000	5.15	100	92	91	86	83	80	82	84	90
	5.43	100	96	93	88	85	81	82	83	92
	3.76	95	94	96	92	89	84	84	84	95
1100	6.23	101	95	93	89	85	82	83	85	93
	6.57	102	99	95	91	87	83	84	85	94
	4.48	97	97	97	94	91	87	86	86	97
1200	7.41	102	99	94	91	87	84	85	87	95
	7.82	103	102	96	93	89	86	85	86	96
	5.26	99	99	99	97	93	89	87	87	99
1300	8.70	103	102	96	94	90	87	87	89	97
	9.17	105	104	98	96	92	88	87	88	98

Values shown are for inlet Lwi and inlet Lwi(A) sound power levels for installation Type B: free inlet, ducted outlet. The sound power level ratings shown are in decibels, refer to 10<sup>-12</sup> watts, calculated per AMCA International Standard 301. The A-weighted sound ratings shown have been calculated per AMCA International Standard 301.

Alreng Company  
certifies that the SWSI  
Centrifugal fan shown  
herein is licensed to  
bear the **AMCA Seal**.  
The ratings shown are  
based on tests and  
procedures performed in  
accordance with **AMCA  
Publication 211 and 311**  
and comply with the  
requirements of the  
**AMCA Certified Ratings  
Program**.



*Backward Centrifugal*  
**SWSI**